


SLIDING DOOR 2100 x 1800 XO
Test 0066 27/10/2008

Construction:

Sill	WASD075
Head	WASD065
Jamb	WASD053
Lock Stile	WASD054
Receiver Channel	WASD059
Interlock	WASD066
Mullion	WASD056
Jamb Stile	WASD057
Rails	WASD060
Threshold	WASD064

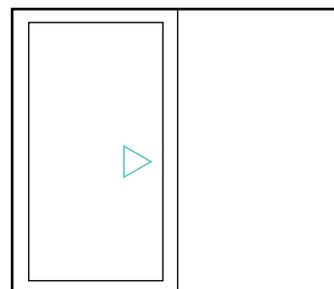

Seals:

Jamb Stile	PBF48-425
Threshold	PBF48-425
Rails	PBF48-425
Mullion	6.5mm Q-LON
Lockstile / Interlock	7.5mm Q-LON

Glass:

10mm Clear Toughened

Results:

Test	Standard	Result
Deflection (Mullion)	Positive	AS4420.2 N/A
	Negative	AS4420.2 N/A
Operating force	Open - initiating	AS4420.3 N/A
	Open - maintaining	AS4420.3 N/A
	Close	AS4420.3 N/A

Test	Standard	Result
Air infiltration	Positive @ 75Pa	AS4420.4 N/A
	Negative @ 75Pa	AS4420.4 N/A
	Positive @ 150Pa	AS4420.4 N/A
	Negative @ 150Pa	AS4420.4 N/A
Water penetration resistance	AS4420.5	450Pa
Ultimate strength	Positive	AS4420.6 4500Pa
	Negative	AS4420.6 9000Pa

For further details please refer to the complete test report.