


SLIDING DOOR 2100 x 3800 OXXO
Test 0138 21/03/2013

Construction:

Sill	WASD075
Head	WASD065
Jamb	WASD053
Lock Stile	WASD054
Receiver Channel	WASD059
Interlock	WASD066
Mullion	WASD056
Jamb Stile	WASD057
Rails	WASD060
Threshold	WASD064

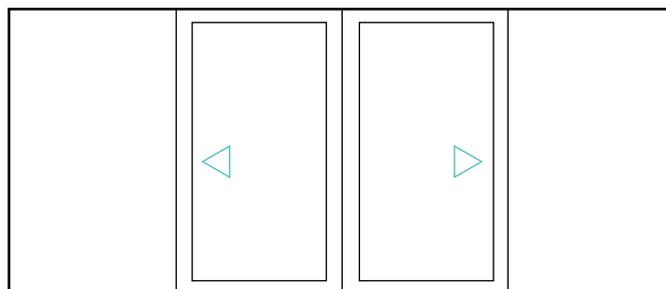

Seals:

Jamb & Lock Stile	SWA082
Mullion	SDA029
Interlock	SAW002
Rails	PBF48-550
Threshold	PBF48-750

Glass:

6mm Clear Toughened

Results:

	Test	Standard	Result
Deflection (span 1)	Positive	AS4420.2	Span/469 @ 2200Pa
	Negative	AS4420.2	Span/433 @ 2201Pa
Deflection (span 2)	Positive	AS4420.2	Span/394 @ 2200Pa
	Negative	AS4420.2	Span/420 @ 2201Pa
Deflection (span 3)	Positive	AS4420.2	Span/445 @ 2200Pa
	Negative	AS4420.2	Span/448 @ 2201Pa
Operating force 'A'	Open - initiating	AS4420.3	172N
	Open - maintaining	AS4420.3	32N
	Close	AS4420.3	40N
Operating force 'B'	Open - initiating	AS4420.3	52N
	Open - maintaining	AS4420.3	48N
	Close	AS4420.3	64N

SLIDING DOOR 2100 x 3800 OXXO
Test 0138 21/03/2013

Results:

	Test	Standard	Result
Air infiltration	Positive @ 75Pa	AS4420.4	0.04l/S/M ²
	Negative @ 75Pa	AS4420.4	0.34l/S/M ²
	Positive @ 150Pa	AS4420.4	0.05l/S/M ²
	Negative @ 150Pa	AS4420.4	0.50l/S/M ²
Water penetration resistance		AS4420.5	450Pa
Ultimate strength	Positive	AS4420.6	4104Pa
	Negative	AS4420.6	8546Pa

For further details please refer to the complete test report.